


IMPORTANT SAFETY INFORMATION. READ AND FOLLOW ALL SAFETY INSTRUCTIONS. Follow label information and instructions concerning Wet or Damp Locations, installation near combustible materials, insulation, building materials, and proper lamping. Do not install in areas subject to combustible vapors or gases. Before wiring to power supply and during servicing or relamping, turn off power at fuse or circuit breaker. **All servicing or relamping must be performed by qualified service personnel. Product must be grounded to avoid potential electric shock or other potential hazard. Product must be mounted in locations and at heights and in a manner consistent with its intended use, and in compliance with the National Electrical Code and local codes.** The use of accessory equipment not recommended by the manufacturer or installed contrary to instructions may cause an unsafe condition. Do not block light emanating from product in whole or part, as this may cause an unsafe condition. Do not allow items such as drapes, curtains, screens or the like to come into contact with the product or to block light from the product, as this may cause an unsafe condition.

INSTALLATION INSTRUCTIONS CFR813/18/26 EB/EBDM

1. Install the fixture in the ceiling using mounting channel or bar (by others) placed in the adjustable mounting brackets. Mount the fixture in the ceiling so that the weight of the fixture is supported by the mounting channel or bar and/or hanger wires secured to the building structure.

NOTE: FIXTURE MUST BE INSTALLED WITH LAMP SOCKETS ADJACENT TO THE SURFACE TO BE ILLUMINATED.

2. Adjust the fixture so the bottom of the plaster flange is flush with the ceiling line and in alignment with adjacent fixtures. Secure mounting brackets by tightening adjustment screws on either side of the fixture.
3. Determine where the supply wiring conduit will enter the J-Box and attach it in conformance with the National Electric Code.
4. Remove ballast assembly from J-Box. Connect power supply leads to black (line) and white (common) ballast leads. Connect ground wire. Reinstall J-Box cover. **WARNING: Do not pinch wires between J-Box cover and J-Box!**
5. Install the ballast assembly by positioning the tab on the ballast mounting plate in the slot on the J-Box bottom plate. Secure ballast assembly by snapping ballast plate under J-Box Spring.
6. After all ceiling installation and finishing work is complete, install the reflector so that the kicker reflector is opposite the surface to be illuminated.
7. Install the proper lamps (by others).

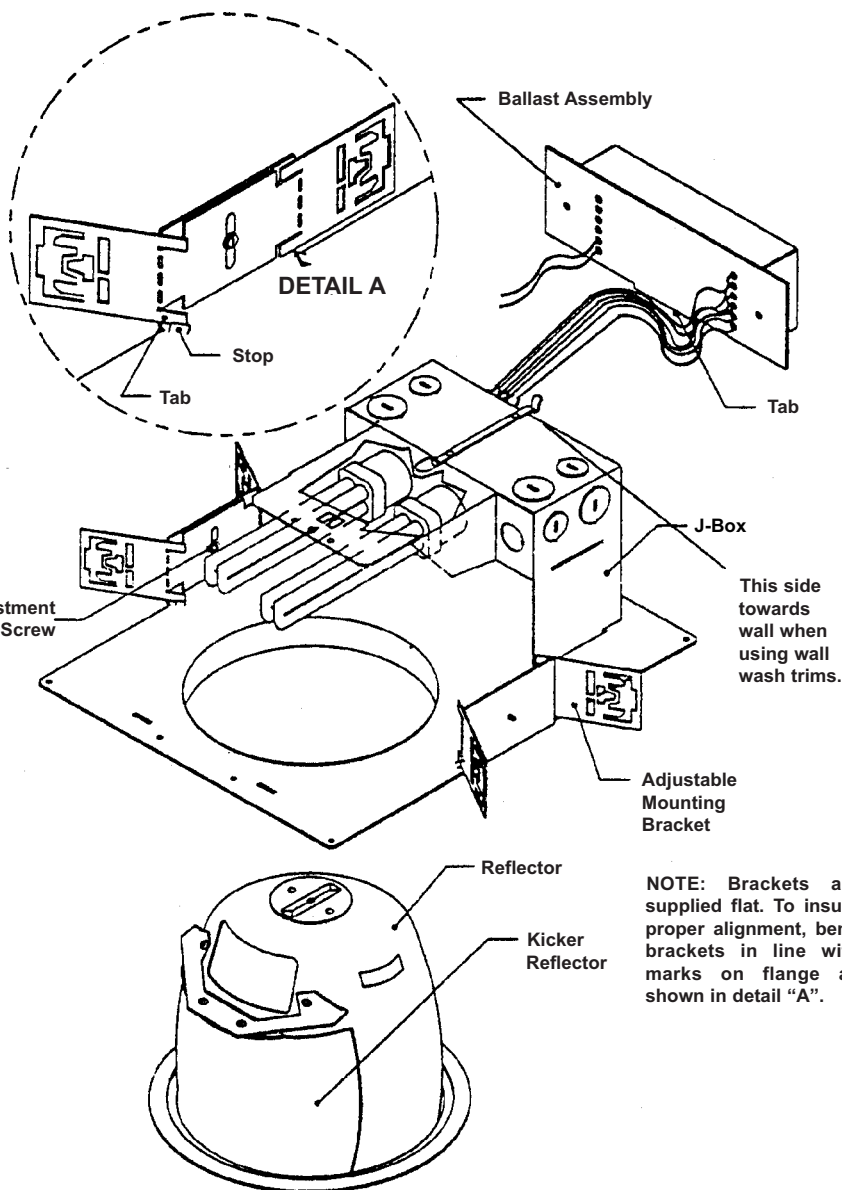

CAUTION: DO NOT ATTEMPT TO MODIFY OR REWIRE FACTORY-INSTALLED WIRING ON THE FIXTURE. SAFETY AND PROPER OPERATION OF THE FIXTURE DEPEND ON THE INTEGRITY OF THE WIRING.

